


1001 Resources availability ratio (%)

Resources availability ratio = Average daily transmission input[m³/day]
/ Resource capacity[m³/day] x 100 (%)

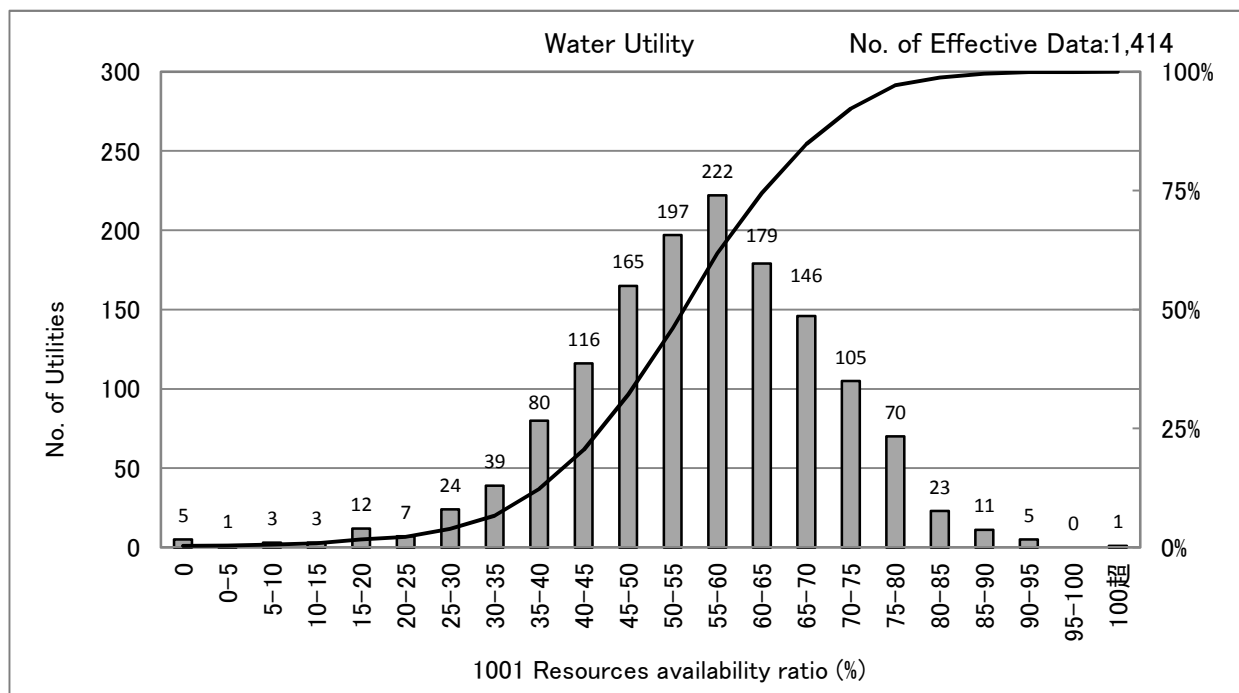


[Percentile Value] Water Utility
Fiscal year

F.Y.	95%	75%	50%	25%	5%
2008	75.8	63.7	55.6	47.4	32.1
2009	75.5	64.1	55.4	47.2	32.4
2010	76.9	64.8	56.5	47.8	33.1
2011	76.8	64.8	56.2	47.3	32.7
2012	77.3	65.2	56.2	46.6	32.6

Population supplied (F.Y.2012)

People	95%	75%	50%	25%	5%
<=1	74.4	62.0	50.1	39.1	18.9
1-3	76.5	63.7	53.6	45.9	35.7
3-10	78.1	67.7	58.4	51.5	40.3
10-50	77.1	69.3	60.6	53.2	41.4
50<	79.4	64.2	59.4	56.1	43.8

× 10,000people

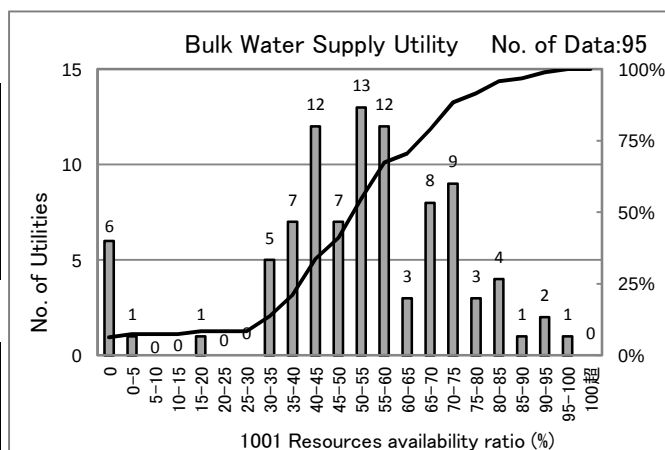

[Percentile Value]	F.Y.	95%	75%	50%	25%	5%
Bulk Water Supply Utility	2009	82.7	63.8	52.2	41.4	0.0
	2010	82.0	64.4	51.4	40.6	0.0
	2011	81.3	64.3	53.5	40.6	0.0
	2012	82.2	67.3	53.9	42.1	0.0

[Scatter Plot]

