


1003 Effective raw water ratio (%)

Effective raw water ratio = Annual effective volume[m³/day] / Annual intake volume[m³/day] x 100 (%)

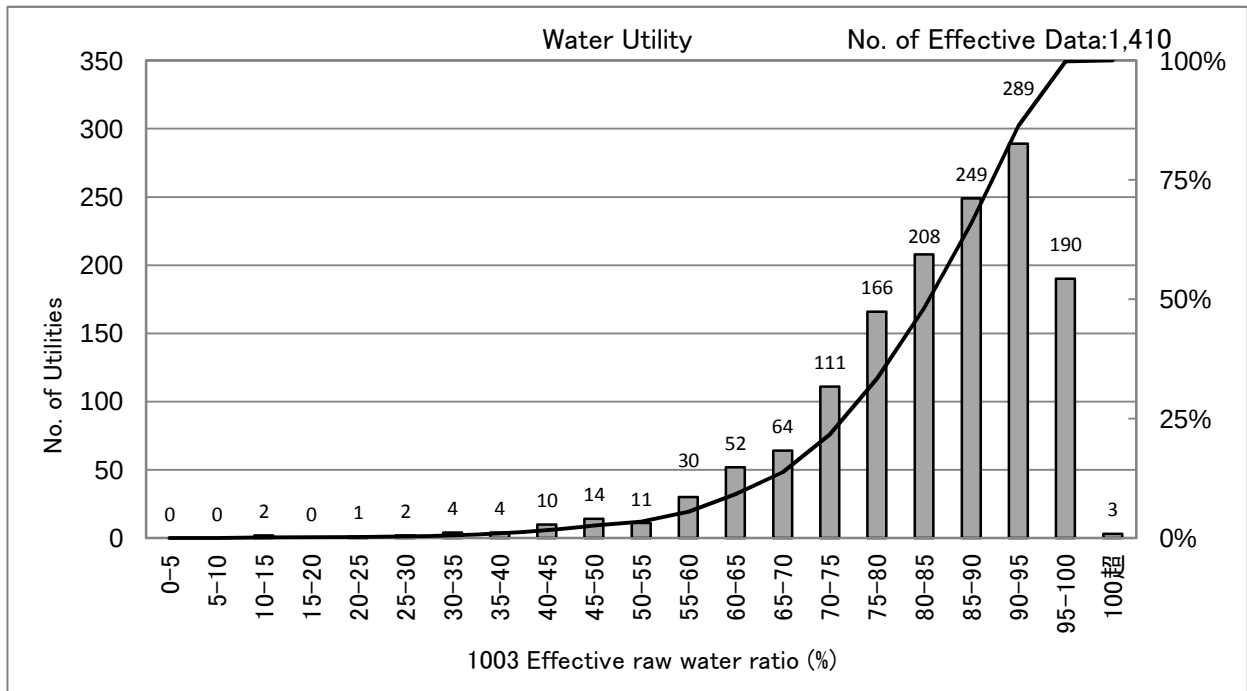

[Percentile Value] Water Utility


Fiscal year

F.Y.	95%	75%	50%	25%	5%
2008	97.9	92.3	86.3	78.4	61.6
2009	97.8	92.3	86.1	78.0	62.0
2010	97.7	92.3	86.3	78.2	61.9
2011	97.5	92.1	85.2	76.4	59.2
2012	97.6	92.2	85.7	76.8	59.1

Population supplied (F.Y.2012)

People	95%	75%	50%	25%	5%
<=1	96.0	87.3	77.2	66.1	45.8
1-3	97.4	89.7	82.8	75.9	60.3
3-10	97.1	93.0	87.8	81.5	67.6
10-50	98.1	95.7	92.7	87.5	80.4
50<	96.8	94.1	92.8	90.9	86.8

× 10,000people

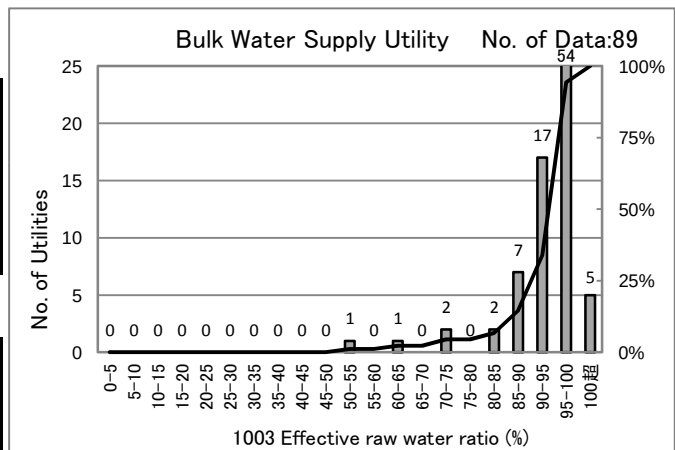

[Percentile Value]	F.Y.	95%	75%	50%	25%	5%
Bulk Water	2009	99.9	98.6	96.5	93.1	84.9
Supply Utility	2010	100.0	98.5	96.8	93.6	82.4
	2011	100.0	98.7	96.6	93.1	83.5
	2012	100.1	98.7	96.6	93.4	81.8

[Scatter Plot]

