


1107 Compliance for TTHM (%)

Compliance for TTHM = Maximum TTHM concentration / Standard TTHM concentration x 100 (%)

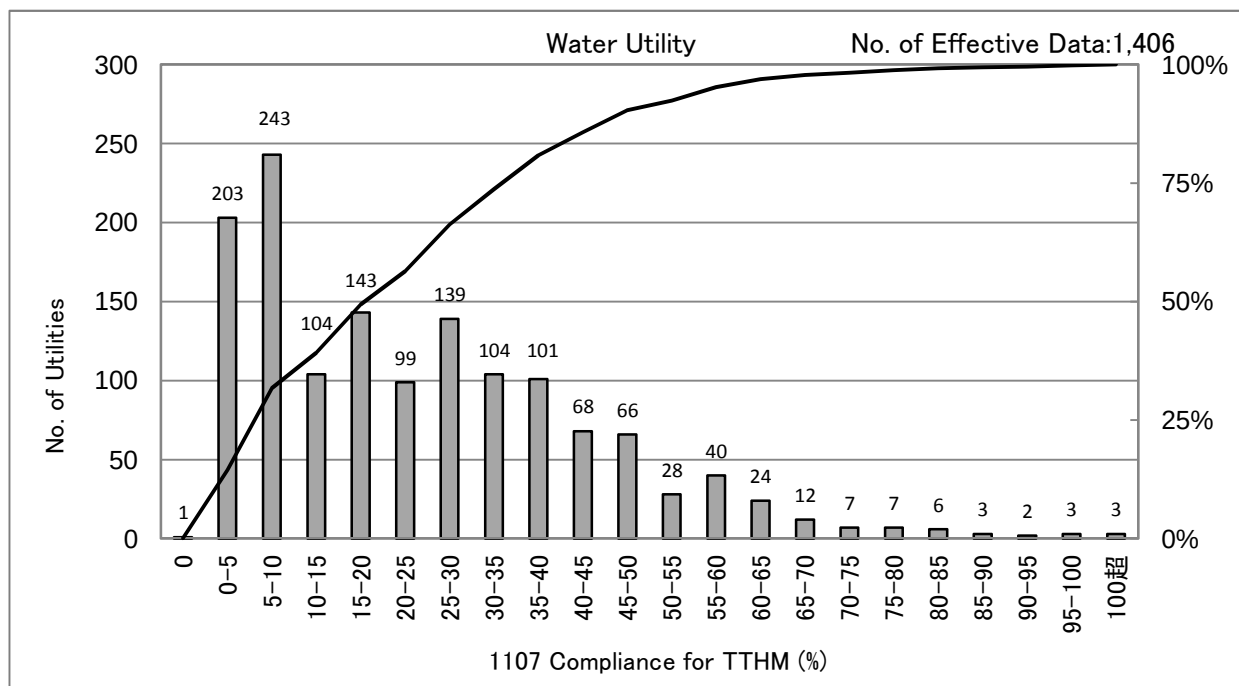

[Percentile Value] Water Utility

Fiscal year

F.Y.	95%	75%	50%	25%	5%
2008	60	37	20	10	1
2009	61	36	21	10	1
2010	62	37	21	10	1
2011	61	36	21	10	1
2012	60	36	21	10	1

Measurement Material	Water Quality Std.
Total Trihalomethane (TTHM)	0.1mg/L

Population supplied (F.Y.2012)

People	95%	75%	50%	25%	5%
<=1	52	27	11	5	1
1-3	56	34	18	10	1
3-10	64	41	27	12	2
10-50	64	42	30	20	9
50<	49	36	30	24	16

× 10,000people

[Scatter Plot]

