


1110 Compliance for heavy metals (%)

Compliance for heavy metals = $\sum$ (Maximum concentration of each heavy metal / Target concentration of each heavy metal) / 6 x 100 (%)

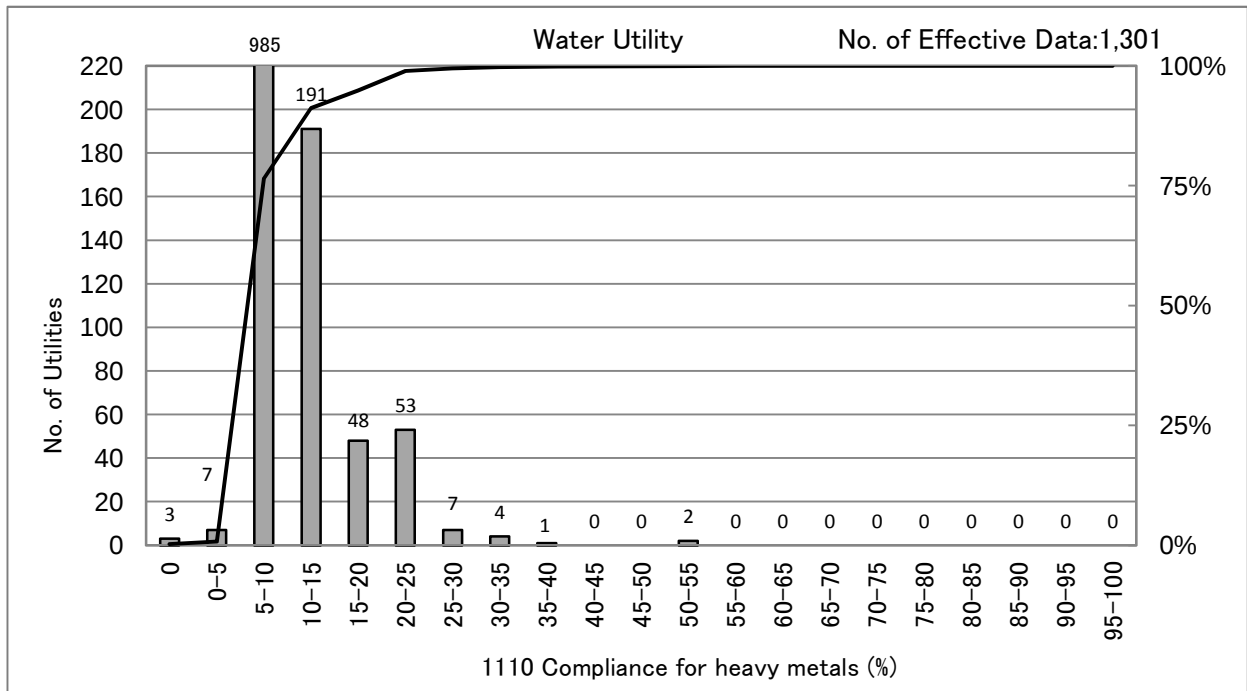

[Percentile Value] Water Utility

Fiscal year

F.Y.	95%	75%	50%	25%	5%
2008	14	8	6	6	6
2009	16	8	6	6	6
2010	23	11	8	8	8
2011	23	11	8	8	8
2012	21	9	8	8	8

Heavy Metals	Water Quality Std.
Cadmium and its compounds	0.003mg/L
Mercury and its compounds	0.0005mg/L
Selenium and its compounds	0.01mg/L
Lead and its compounds	0.01mg/L
Arsenic and its compounds	0.01mg/L
Hexavalent chromium	0.05mg/L

Population supplied (F.Y.2012)

People	95%	75%	50%	25%	5%
<=1	18	9	8	8	7
1-3	19	9	8	8	6
3-10	23	11	8	8	8
10-50	16	9	8	8	8
50<	19	13	8	8	6

× 10,000people

[Scatter Plot]

