


1113 Compliance for chlorinated organic compounds (%)

Compliance for chlorinated organic compounds = $\sum (\text{Maximum concentration of each chlorinated organic compound} / \text{Target concentration of each chlorinated organic compound}) / 8 \times 100 (\%)$

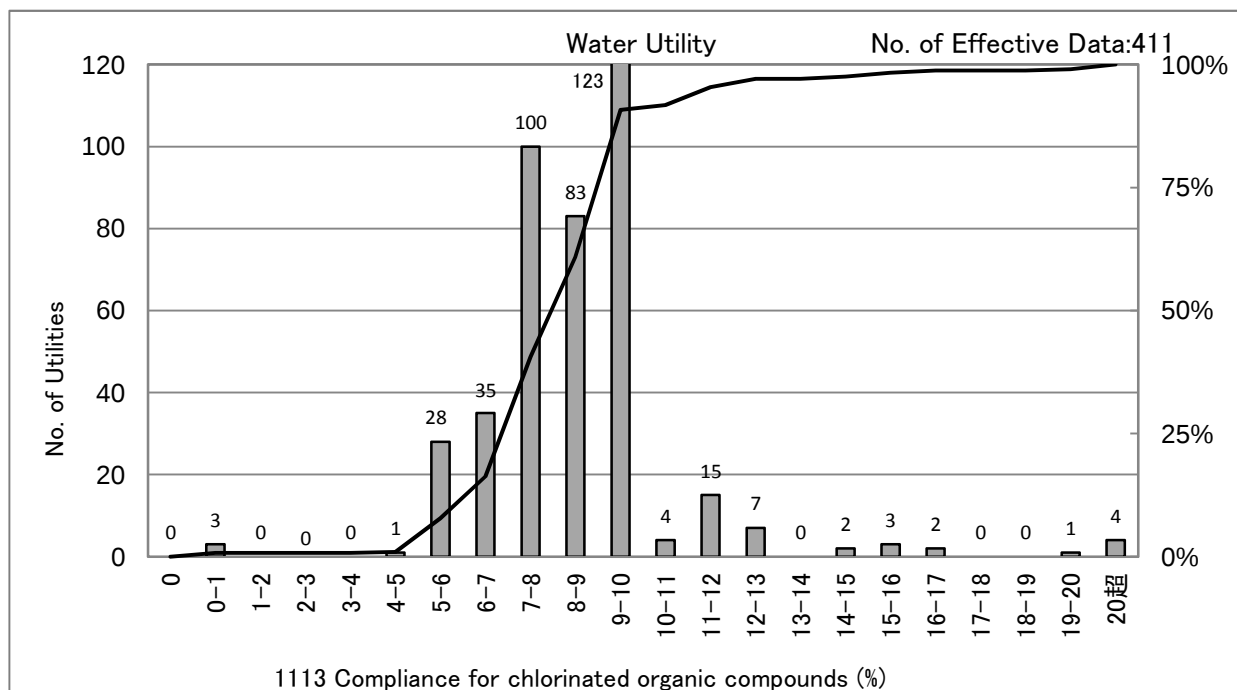

[Percentile Value] Water Utility

Fiscal year

F.Y.	95%	75%	50%	25%	5%
2008	10	10	9	7	5
2009	10	10	8	6	5
2010	10	10	9	6	5
2011	13	10	9	7	6
2012	12	10	9	7	6

Population supplied (F.Y.2012)

People	95%	75%	50%	25%	5%
<=1	10	9	8	7	6
1-3	12	10	9	8	7
3-10	13	10	9	7	7
10-50	12	10	8	7	6
50<	10	10	8	7	6

× 10,000people

Chlorinated Organic Compounds	Water Quality Std.
Carbon Tetrachloride	0.002mg/L
1,1-Dichloroethylene	* ¹ 0.1mg/L
Dichloromethane	0.02mg/L
cis-1,2-Dichloroethylene and trans-1,2-Dichloroethylene	0.04mg/L
Tetrachloroethylene	0.01mg/L
Trichloroethylene	0.01mg/L
Benzene	0.01mg/L
1,2-Dichloroethane	* ¹ 0.004mg/L

*¹ Values of 1,1-Dichloroethylene and 1,2-Dichloroethane are the target values for water quality management.

* 1,1,2-Trichloroethane was removed from the targets for water quality management on April 1, 2010.

[Scatter Plot]

