


1114B Compliance for disinfection by-products (%)

Compliance for disinfection by-products (not include Chloric acid) = $\sum (\text{Maximum concentration of each disinfection by-product} / \text{Target concentration of each disinfection by-product}) / 5 \times 100 (\%)$

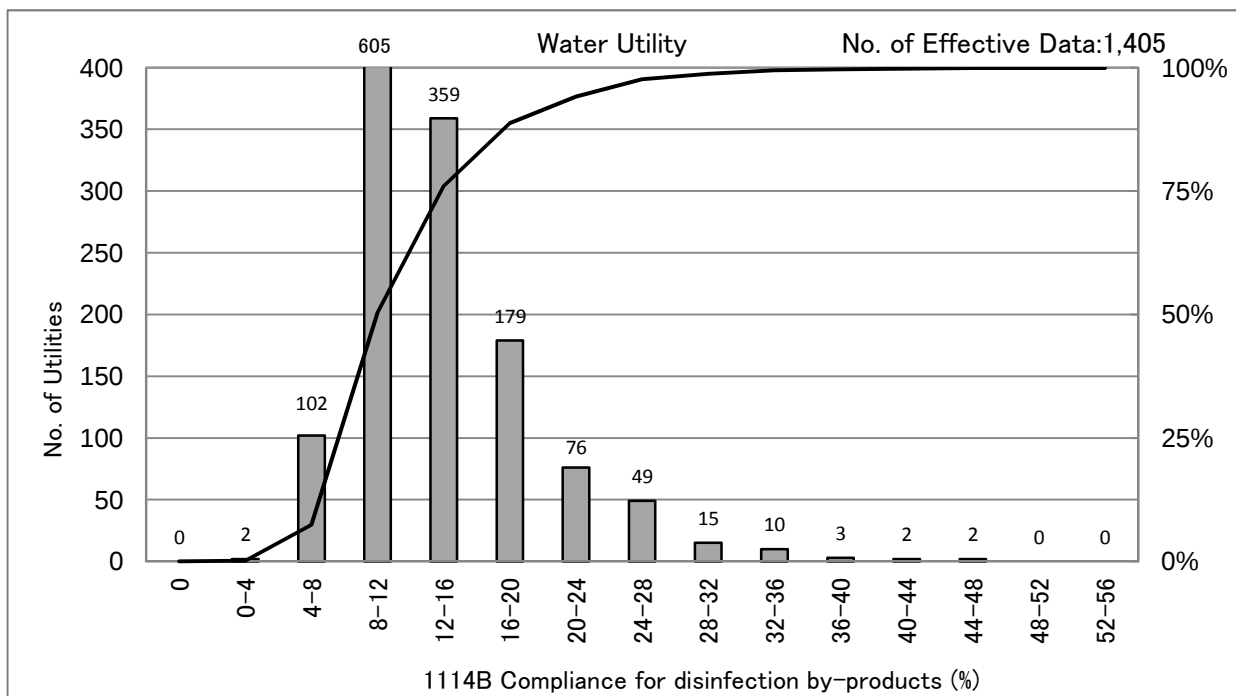

[Percentile Value] Water Utility

Fiscal year

F.Y.	95%	75%	50%	25%	5%
2008	20	13	10	10	6
2009	20	12	10	10	6
2010	25	16	12	10	8
2011	25	16	12	10	8
2012	25	16	12	10	8

Disinfection By-Products	Water Quality Std.
Bromic acid	0.01mg/L
Chloroacetic acid	0.02mg/L
Dichloroacetic acid	0.04mg/L
Trichloroacetic acid	0.2mg/L
Formaldehyde	0.08mg/L

Population supplied (F.Y.2012)

People	95%	75%	50%	25%	5%
<=1	22	14	11	10	7
1-3	25	15	12	10	8
3-10	26	17	13	10	8
10-50	24	17	13	11	9
50<	25	17	13	11	9

× 10,000people

[Scatter Plot]

