


2002 Transmission input per population supplied (L/day/person)

Transmission input per population supplied = Average daily transmission input[m³/day]
/ Service population[person] x 1,000 (L/day/person)

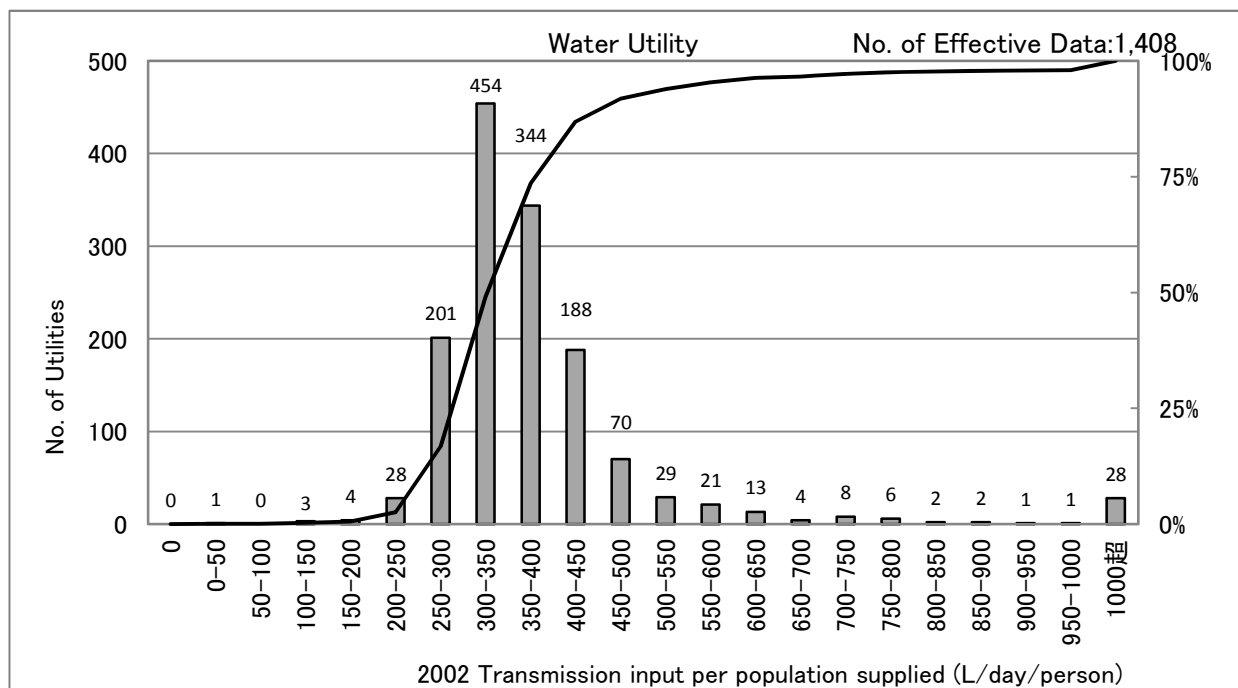

[Percentile Value] Water Utility

Fiscal year

F.Y.	95%	75%	50%	25%	5%
2008	602	407	352	312	261
2009	597	403	349	312	265
2010	588	409	353	315	269
2011	581	404	352	311	267
2012	577	404	352	311	267

Population supplied (F.Y.2012)

People	95%	75%	50%	25%	5%
<=1	1,531	459	380	323	263
1-3	568	417	363	310	265
3-10	476	389	342	309	267
10-50	404	360	332	309	281
50<	368	341	323	316	279

x 10,000people

[Scatter Plot]

