


2003 Surplus capacity of purification (%)

Surplus capacity of purification = $\{(\text{Daily treatment capacity}[\text{m}^3/\text{day}] - \text{Maximum daily treatment capacity}[\text{m}^3/\text{day}]) / \text{Daily treatment capacity}[\text{m}^3/\text{day}]\} \times 100 (\%)$

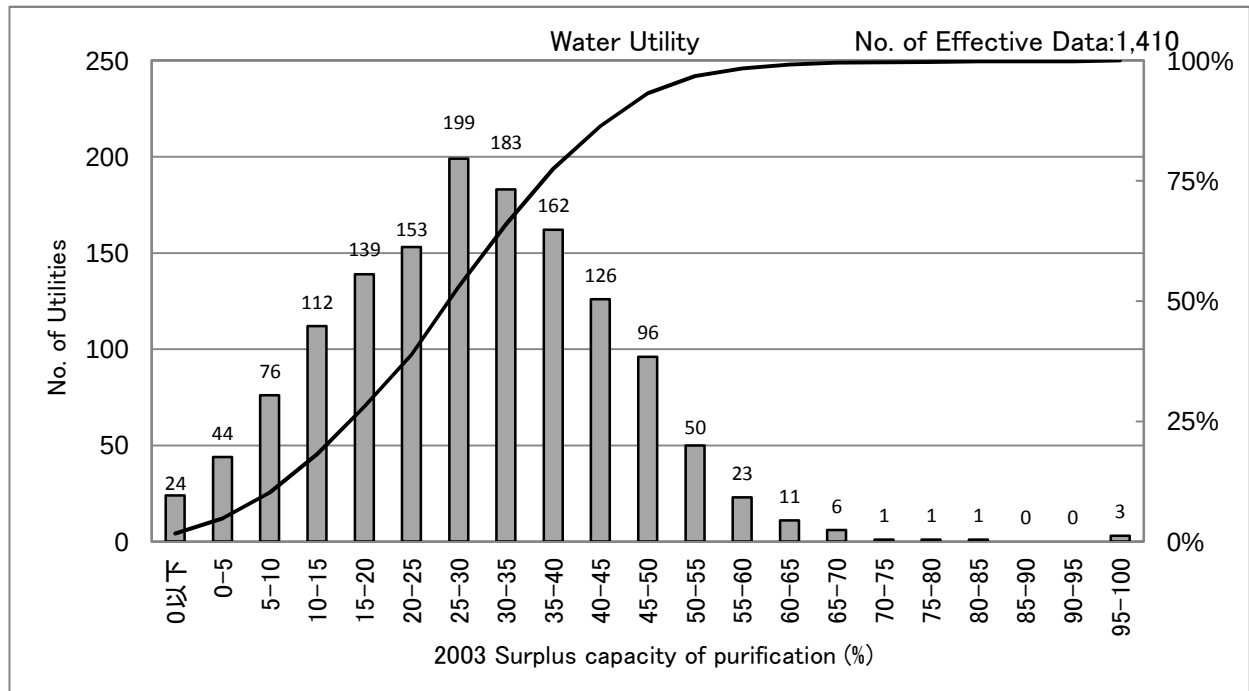


[Percentile Value] Water Utility
Fiscal year

F.Y.	95%	75%	50%	25%	5%
2008	51.1	36.5	27.4	17.5	4.3
2009	52.1	38.1	28.3	18.5	6.1
2010	50.5	36.7	26.6	16.7	2.7
2011	51.9	37.9	27.2	17.0	3.4
2012	52.8	39.0	29.0	18.7	5.5

Population supplied (F.Y.2012)

People	95%	75%	50%	25%	5%
<=1	58.7	43.4	30.8	16.9	3.1
1-3	53.1	39.5	28.9	19.2	5.2
3-10	48.7	37.3	29.0	20.0	6.9
10-50	46.2	35.0	27.1	17.4	7.9
50<	45.0	36.5	30.1	25.5	17.3

× 10,000people

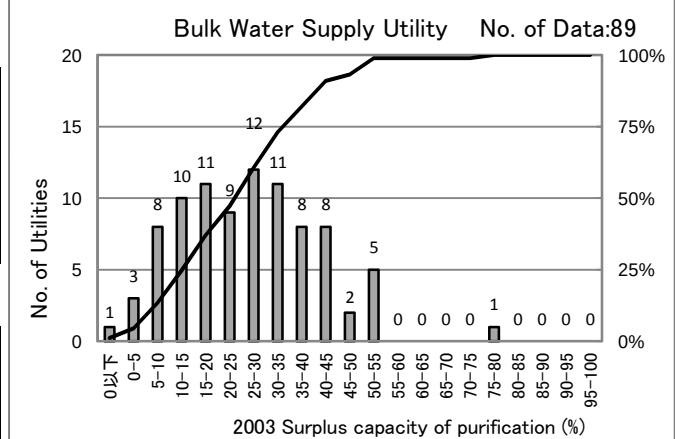

[Percentile Value]	F.Y.	95%	75%	50%	25%	5%
Bulk Water	2009	49.6	36.6	26.5	16.5	4.4
Supply Utility	2010	49.2	34.5	24.4	12.4	3.6
	2011	50.4	34.8	24.6	15.9	5.9
	2012	50.5	35.5	26.2	15.4	6.2

[Scatter Plot]

