


2104 Mains rehabilitation (%)

Mains rehabilitation = Length of replaced pipelines[km]
/ Total pipeline length[km] x 100 (%)

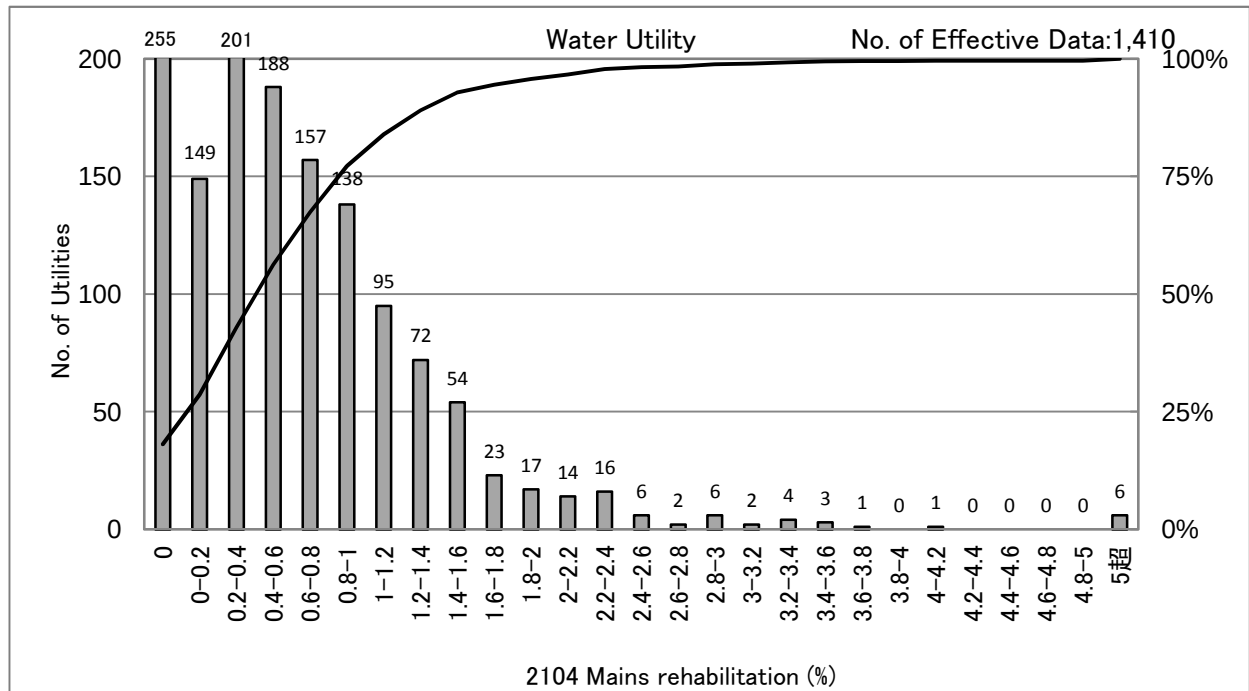


[Percentile Value] Water Utility
Fiscal year

F.Y.	95%	75%	50%	25%	5%
2008	2.57	1.21	0.59	0.10	0.00
2009	2.36	1.16	0.57	0.10	0.00
2010	2.09	1.05	0.58	0.11	0.00
2011	1.98	1.00	0.52	0.11	0.00
2012	1.87	0.94	0.50	0.12	0.00

Population supplied (F.Y.2012)

People	95%	75%	50%	25%	5%
<=1	2.24	0.68	0.14	0.00	0.00
1-3	2.01	1.02	0.45	0.09	0.00
3-10	1.62	0.94	0.56	0.32	0.00
10-50	1.59	1.05	0.74	0.47	0.17
50<	1.66	1.09	0.84	0.59	0.06

× 10,000people

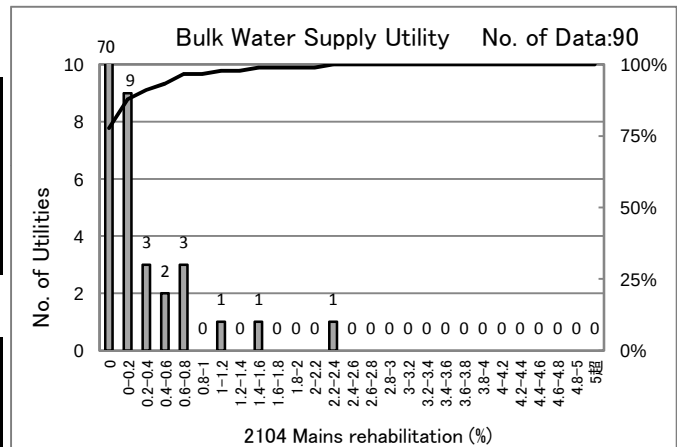

[Percentile Value]	F.Y.	95%	75%	50%	25%	5%
Bulk Water	2009	0.3	0.0	0.0	0.0	0.0
Supply Utility	2010	0.3	0.0	0.0	0.0	0.0
	2011	0.5	0.0	0.0	0.0	0.0
	2012	0.7	0.0	0.0	0.0	0.0

[Scatter Plot]

