


2203 Available water volume in an accident (%)

Available water volume in an accident = Reduced transmission input[m³/day]
/ Average daily transmission input[m³/day] x 100 (%)

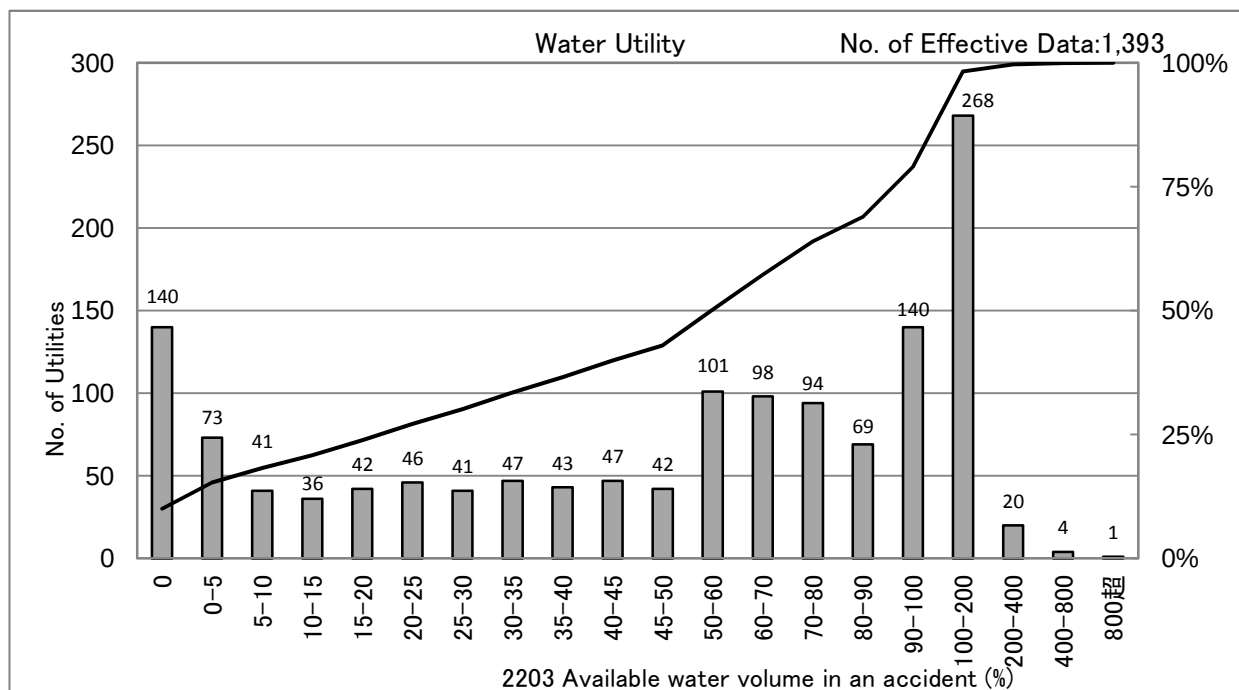

[Percentile Value] Water Utility

Fiscal year

F.Y.	95%	75%	50%	25%	5%
2008	148.2	94.4	52.5	8.3	0.0
2009	150.7	96.2	56.4	14.8	0.0
2010	151.8	98.9	58.6	20.2	0.0
2011	150.8	98.4	59.1	21.7	0.0
2012	149.4	99.2	59.7	22.2	0.0

Population supplied (F.Y.2012)

People	95%	75%	50%	25%	5%
<=1	198.8	104.7	71.0	18.5	0.0
1-3	146.1	97.8	59.7	19.8	0.0
3-10	136.3	83.4	51.6	20.3	0.0
10-50	119.6	91.9	61.4	29.5	0.2
50<	127.6	103.0	97.7	76.9	40.8

× 10,000people

[Scatter Plot]

