


2208 Ratio of earthquake-resistant pumping station (%)

Ratio of earthquake-resistant pumping station = Capacity of earthquake-resistant pump stations[m³/day] / Capacity of all pump stations[m³/day] x 100 (%)

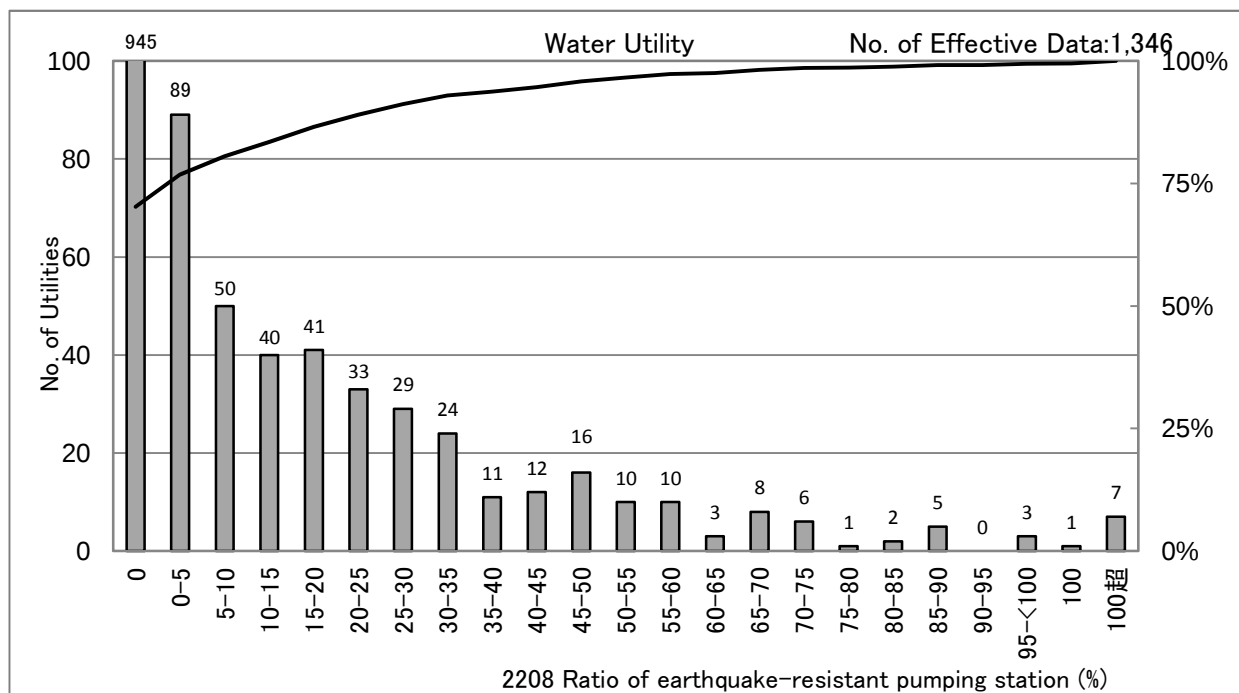


[Percentile Value] Water Utility
Fiscal year

F.Y.	95%	75%	50%	25%	5%
2008	30.0	0.0	0.0	0.0	0.0
2009	36.9	0.0	0.0	0.0	0.0
2010	42.3	1.1	0.0	0.0	0.0
2011	45.8	2.5	0.0	0.0	0.0
2012	46.3	3.5	0.0	0.0	0.0

Population supplied (F.Y.2012)

People	95%	75%	50%	25%	5%
<=1	25.6	0.0	0.0	0.0	0.0
1-3	27.4	0.0	0.0	0.0	0.0
3-10	57.3	8.8	0.0	0.0	0.0
10-50	61.4	21.0	2.4	0.0	0.0
50<	97.2	47.2	29.1	9.5	1.0

× 10,000people

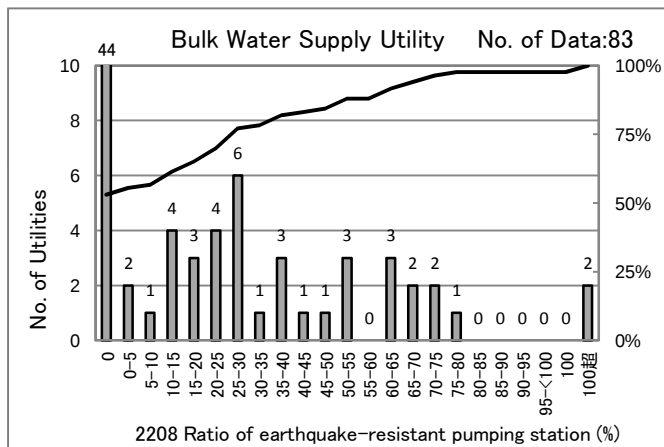

[Percentile Value]	F.Y.	95%	75%	50%	25%	5%
Bulk Water	2009	70.4	29.1	0.0	0.0	0.0
Supply Utility	2010	73.2	29.7	0.0	0.0	0.0
	2011	73.5	28.6	0.0	0.0	0.0
	2012	73.5	28.6	0.0	0.0	0.0

[Scatter Plot]

