


2210A Ratio of earthquake-resistant pipeline (%)

Ratio of earthquake-resistant pipeline = Length of earthquake-resistant pipelines[km]
/ Total pipeline length[km] x 100 (%)

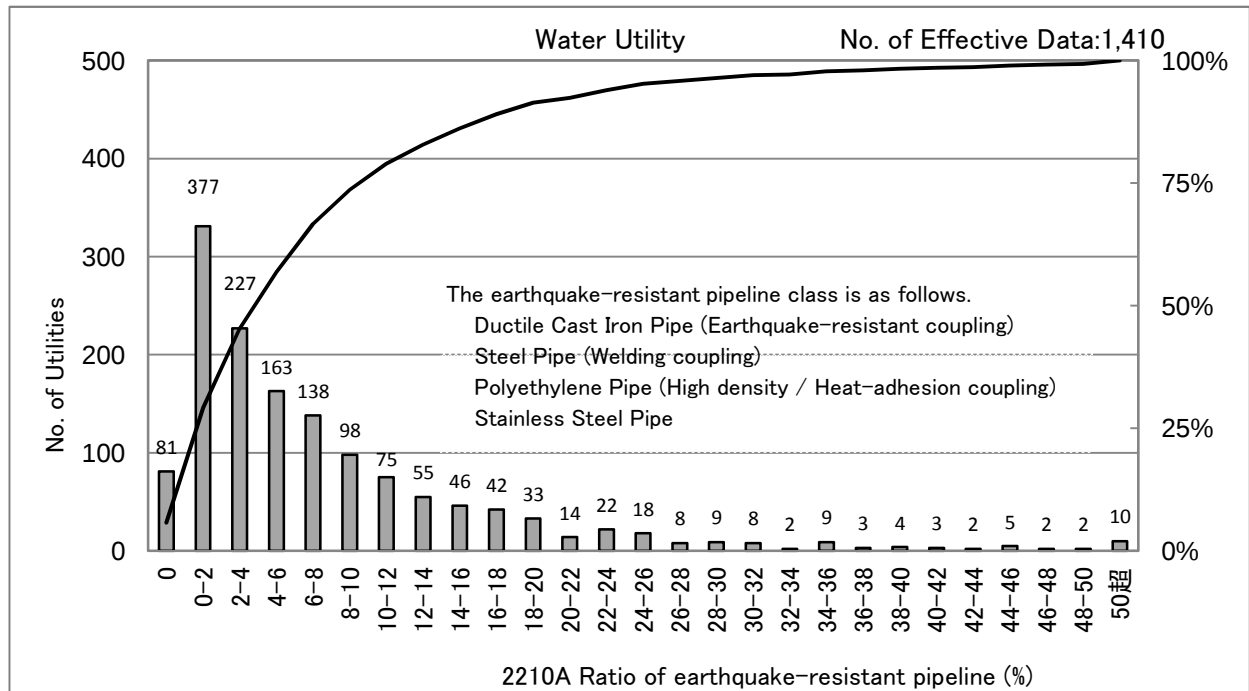


[Percentile Value] Water Utility
Fiscal year

F.Y.	95%	75%	50%	25%	5%
2008	23.0	6.5	1.9	0.3	0.0
2009	22.9	7.4	2.7	0.6	0.0
2010	23.8	8.6	3.4	0.8	0.0
2011	24.7	9.6	4.1	1.2	0.0
2012	25.1	10.6	4.7	1.4	0.0

Population supplied (F.Y.2012)

People	95%	75%	50%	25%	5%
<=1	27.7	7.5	2.4	0.3	0.0
1-3	19.4	8.0	3.6	1.0	0.0
3-10	24.3	10.4	5.4	2.5	0.2
10-50	29.9	15.4	10.0	5.6	2.2
50<	35.3	22.4	18.1	11.0	4.5

× 10,000people

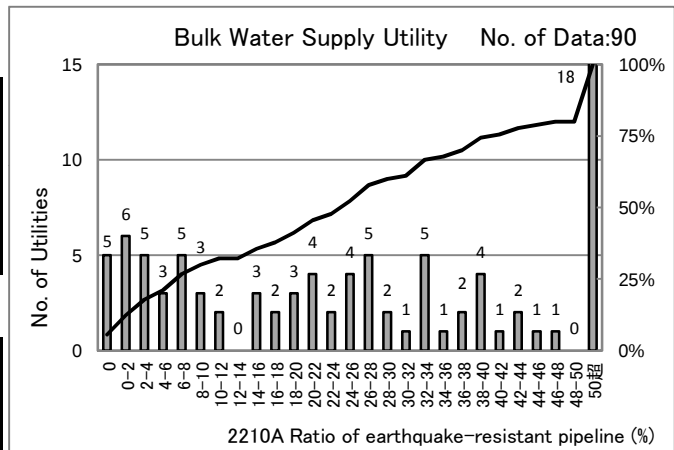

[Percentile Value]	F.Y.	95%	75%	50%	25%	5%
Bulk Water Supply Utility	2009	61.0	37.6	20.4	4.8	0.0
	2010	43.8	32.4	16.9	3.4	0.0
	2011	41.4	31.7	18.8	4.9	0.0
	2012	38.3	26.7	17.5	4.9	0.0

[Scatter Plot]

