


2216 Ratio of non-utility generation facility (%)

Ratio of non-utility generation facility = On-site generation power[kW]
/ Total generation power[kW] x 100 (%)

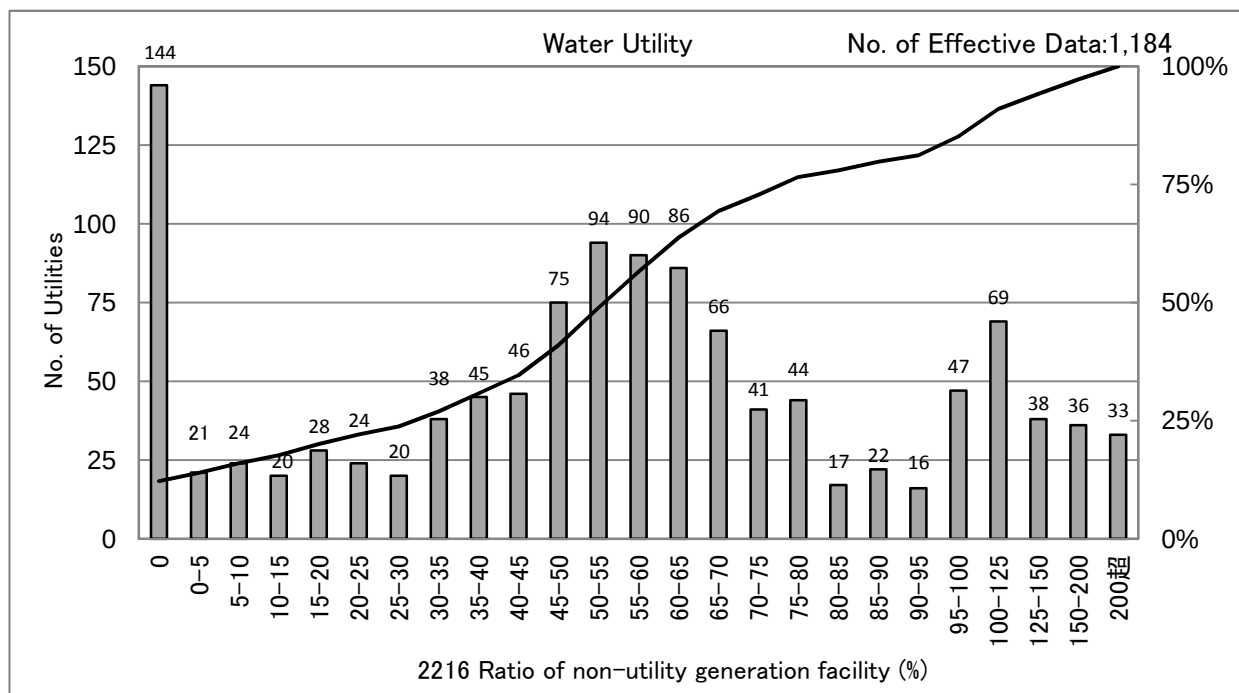

[Percentile Value] Water Utility


Fiscal year

F.Y.	95%	75%	50%	25%	5%
2008	160.6	80.0	54.7	30.3	0.0
2009	156.3	77.3	53.6	28.9	0.0
2010	156.5	76.9	54.0	29.4	0.0
2011	156.3	77.3	54.7	30.7	0.0
2012	160.6	78.2	55.5	32.1	0.0

Population supplied (F.Y.2012)

People	95%	75%	50%	25%	5%
<=1	167.7	79.4	53.3	12.3	0.0
1-3	177.0	81.6	56.9	29.7	0.0
3-10	163.0	75.9	55.8	35.8	0.0
10-50	142.1	71.7	55.5	35.8	0.0
50<	130.5	65.2	51.7	32.0	20.1

× 10,000people

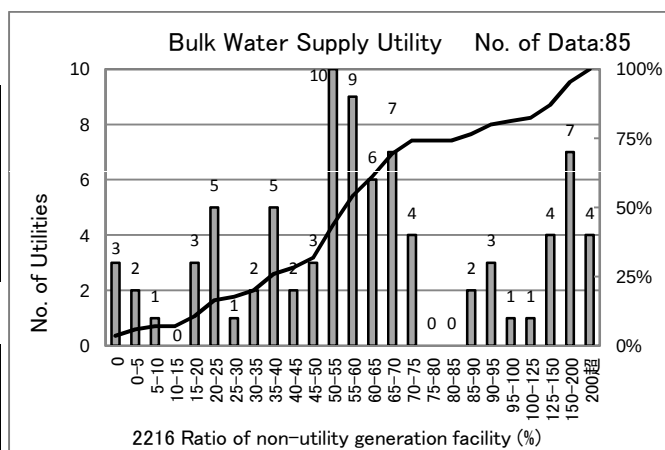

[Percentile

Value]	F.Y.	95%	75%	50%	25%	5%
	2009	235.6	100.3	57.8	37.1	3.8
	2010	237.0	93.7	58.7	38.3	3.6
	2011	239.0	97.1	59.3	42.8	18.9
	2012	190.7	85.4	57.7	40.0	4.1

[Scatter Plot]

