


4001 Electric power consumption per 1m³ transmission input (kWh/m³)

Electric power consumption per 1m³ transmission input = Total power consumption[kWh]
/ Annual transmission input[m³] (kWh/m³)

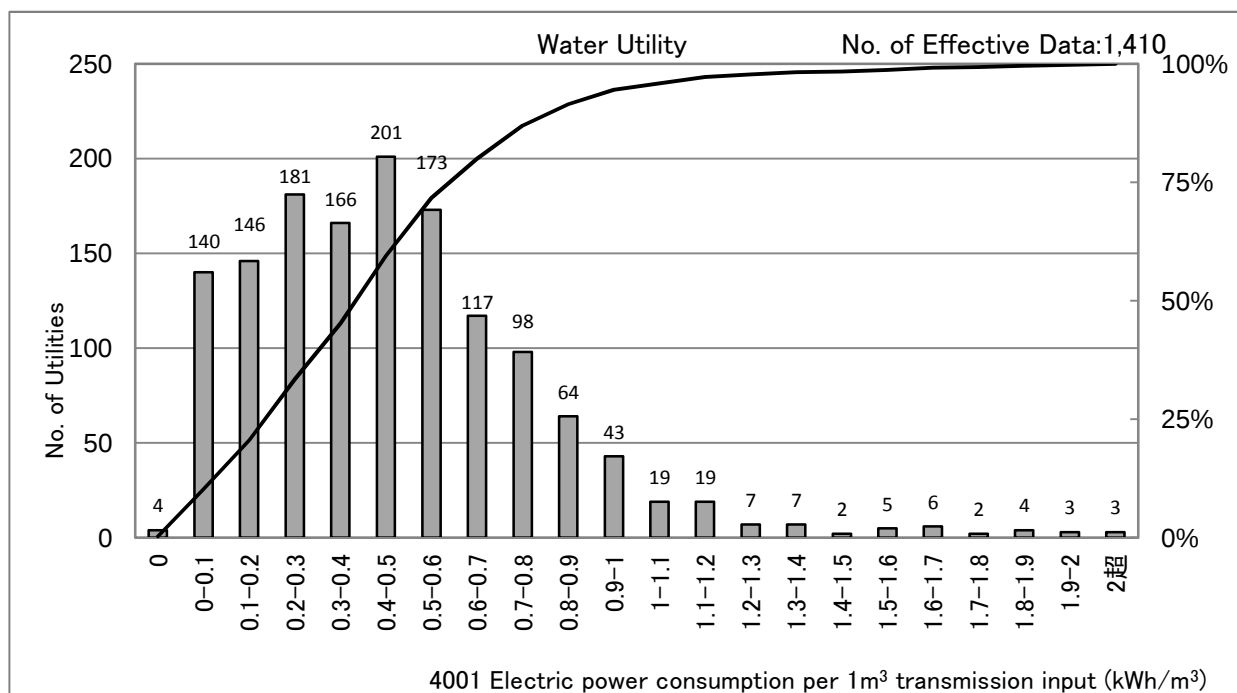

[Percentile Value] Water Utility

Fiscal year

F.Y.	95%	75%	50%	25%	5%
2008	1.00	0.63	0.44	0.24	0.05
2009	1.02	0.63	0.44	0.24	0.04
2010	1.01	0.64	0.44	0.23	0.05
2011	1.01	0.63	0.43	0.24	0.05
2012	1.03	0.63	0.44	0.24	0.05

Population supplied (F.Y.2012)

People	95%	75%	50%	25%	5%
<=1	1.60	0.83	0.56	0.29	0.03
1-3	0.94	0.71	0.48	0.23	0.04
3-10	0.82	0.55	0.42	0.26	0.07
10-50	0.63	0.45	0.31	0.21	0.06
50<	0.54	0.41	0.29	0.14	0.10

× 10,000people

[Scatter Plot]

