


5112 Valve density (No./km)

Valve density = Number of valves[No.] / Total pipeline length[km] (No./km)

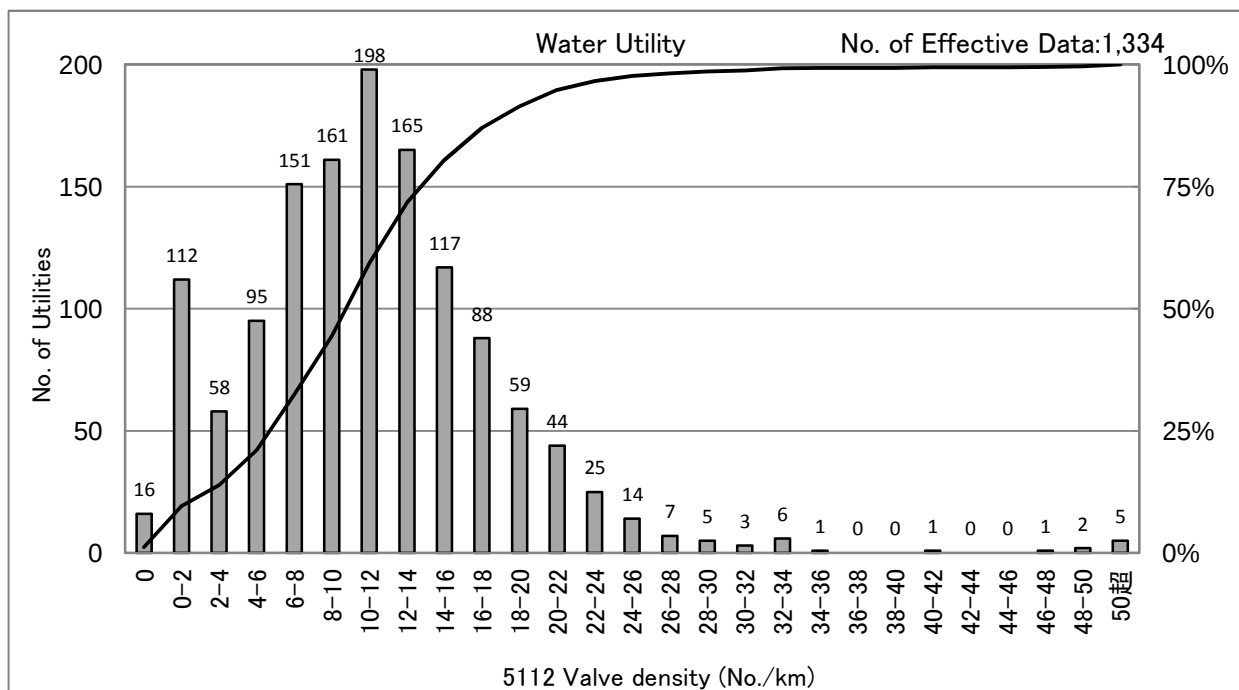

[Percentile Value] Water Utility


Fiscal year

F.Y.	95%	75%	50%	25%	5%
2008	21.6	14.6	10.4	7.0	0.5
2009	21.8	14.8	10.5	6.9	0.3
2010	22.0	14.8	10.7	7.0	0.4
2011	22.1	14.8	10.7	7.0	0.1
2012	22.2	14.8	10.7	6.9	0.1

Population supplied (F.Y.2012)

People	95%	75%	50%	25%	5%
<=1	18.5	11.4	7.9	4.8	0.0
1-3	19.2	13.1	9.3	5.7	0.0
3-10	23.4	16.0	11.9	8.7	0.2
10-50	26.6	18.7	15.1	11.8	6.5
50<	16.0	13.9	12.6	10.5	8.2

× 10,000people

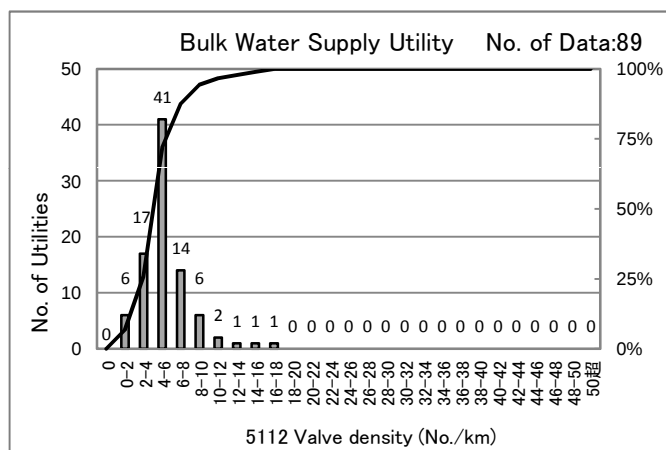

[Percentile Value]
Bulk Water
Supply Utility

F.Y.	95%	75%	50%	25%	5%
2009	11.0	6.2	5.0	3.6	0.8
2010	11.0	6.3	5.2	3.9	1.7
2011	11.1	6.4	5.2	3.8	1.4
2012	10.1	6.3	5.2	3.8	1.4

[Scatter Plot]

